


# Certificate of Analysis

### Reference Material & Standard

|                           |                                                                   |                          |                                           |
|---------------------------|-------------------------------------------------------------------|--------------------------|-------------------------------------------|
| <b>Product Name:</b>      | Oseltamivir Impurity 57 HCl                                       | <b>Catalogue Number:</b> | C4X-1720248                               |
| <b>Synonyms:</b>          | N/A                                                               | <b>Lot Number:</b>       | 0917-SA-7825                              |
| <b>CAS Number:</b>        | N/A                                                               | <b>Expiry Date:</b>      | Sep 17, 26                                |
| <b>Molecular Formula:</b> | C <sub>22</sub> H <sub>38</sub> N <sub>2</sub> O <sub>9</sub> HCl | <b>Storage:</b>          | -20°C±5°C Protected from light and Sealed |
| <b>Molecular Weight:</b>  | 474.55 36.46                                                      |                          |                                           |

**Chemical Structure:**

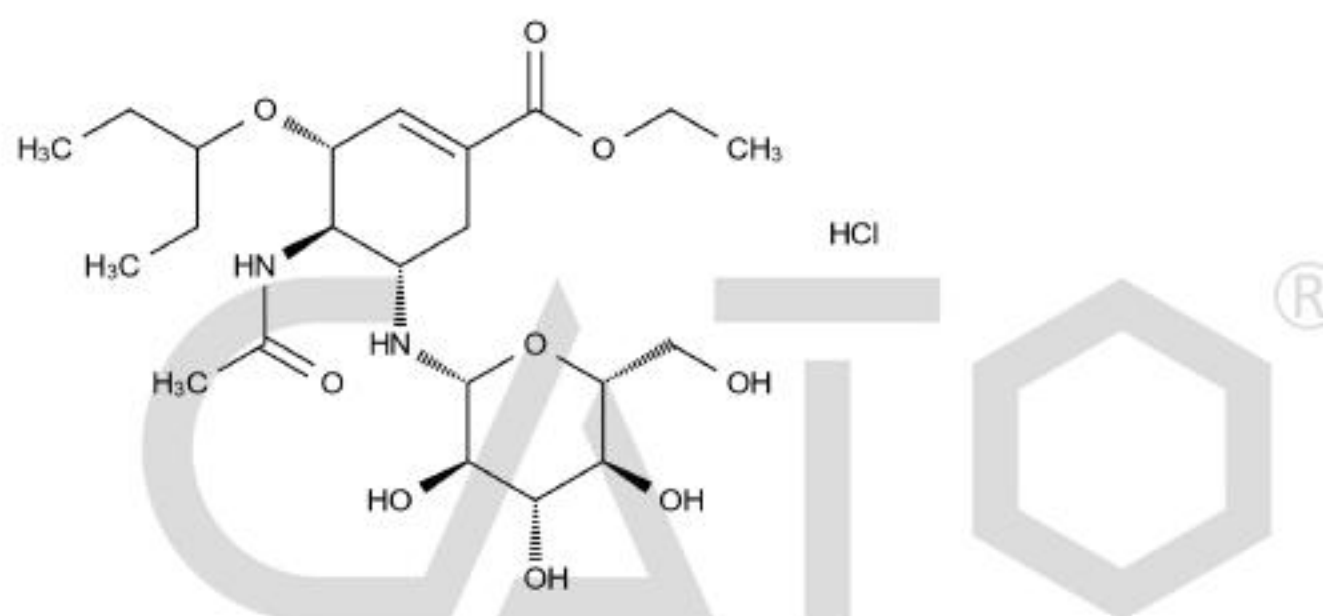

| Test Items      | Method            | Results   |
|-----------------|-------------------|-----------|
| Appearance      | Visual inspection | Solid     |
| Identification: | LC&HNMR           | Confirmed |
| Purity:         | HPLC              | 97.361%   |

**Signature:**

Prepared by:

Lisa

Reviewed by:

Yuki

Approved by General Manager:

David

Date: Sep 17, 24

Date: Sep 17, 24

Date: Sep 17, 24

Add: 3rd Floor, Building B, No.179, Guangpu Rd East, Huangpu District, Guangzhou, China

Tel: +86-20-81960175

Email: [supports@cato-chem.com](mailto:supports@cato-chem.com)

Web: <https://www.cato-chem.com>

Page 1 of 6



Official  
WeChat

## Directions:

1. *Intended use: This product is suitable for identification and quantification of the analyte(s), instrument calibration, method development and quality control in analytical and R&D applications. It is not intended for administration to humans or animals, and shall not be used to diagnose, treat or cure any diseases.*
2. *Minimum sample size: 1mg is recommended as the minimum sample size.*
3. *Metrological traceability: This product meets the requirements of ISO 17034 and is traceable to NMI through an unbroken chain of comparisons.*
4. *Instructions for handling and correct use: Handling in a well-ventilated place.*

## Document Version:

| Revision No. | Date       | Reason for Revision |
|--------------|------------|---------------------|
| 01           | Sep 17, 24 | First release.      |

